COMMONWEALTH OF KENTUCKY

BEFORE THE PUBLIC SERVICE COMMISSION

* * * * *

In the Matter of:

KENTUCKY PUBLIC SERVICE COMMISSION)
vs.) CASE NO. 943
MR. KAY PIGMON D/B/A MEADES BRANCH GAS AND WATER))

SHOW CAUSE ORDER

On February 11 and 12, 1985, the Commission received numerous complaints from customers of Meades Branch Gas and Water ("Meades Branch") in regard to undesirable and potentially hazardous conditions in the Meades Branch area of Lawrence County, Kentucky. The Commission staff investigated this complaint and notified Meades Branch, in writing, of the need for improved construction, better maintenance and more attentive operation. (See Appendix A)

The Commission, having considered the matter and being advised, HEREBY ORDERS that this case be and it hereby is set for hearing on December 18, 1985, at 1:30 p.m., Eastern Standard Time, in Hearing Room No. 2, in the offices of the Commission in Frankfort, Kentucky.

IT IS FURTHER ORDERED that Meades Branch shall appear at the hearing and show cause, if any it can, as to why it should not be subject to the penalties prescribed in KRS 278.990 for failure to comply with the Commission's regulations.

Done at Frankfort, Kentucky, this 24th day of October, 1985.

PUBLIC SERVICE COMMISSION

Rubert D. I Semanit	
Chairman	
Kulhazi	
Vice Chairman 0	
Source Williams, complissioner	1
commissioner	

ATTEST:

Secretary



COMMONWEALTH OF KENTUCKY PUBLIC SERVICE COMMISSION

730 SCHENKEL LANE POST OFFICE BOX 615 FRANKFORT, KY. 40602 (502) 564-3940

August 27, 1985

Mr. Kay Pigmon Route 4, Box 185 Louisa, Ky 41230

Dear Mr. Pigmon:

Enclosed is a copy of a Report on the Investigation of Complaints Relative to Natural Gas and Fresh Water Service by/to Customers on Meades Branch in Lawrence County, Kentucky.

This Report indicates that you are operating a utility as defined by Kentucky Public Service Commission Law [KRS 278.010(3)(b)].

You are requested to acknowledge the receipt of this Report on or before September 25, 1985. In your response please tell us the number of customers, the utility service furnished and the rates charged.

Your prompt response will help us in the handling of the complaints and with our responsibility to assure safe, adequate customer services.

Your failure to answer may lead to enforcement actions by the Commission.

Sincerely,

Claude G. Rhorer, Jr., Director Division of Utility Engineering and Services

Lel H. Rhown

CGR/REB/lr Enclosure

cc: Forest Skaggs, Secretary
Jack Hughes, Legal Division
Byrnes Fairchild, Water Section, Engineering Division

REPORT

TO: Claude G. Rhorer, Jr.

Director

Division of Utility Engineering and Services

THRU: E. Scott Smith, Chief Engineer

Larry L. Amburgey, Investigator Supervisor

FROM: R. E. Bruflat

Utility Investigator

Gas Section

DATE: April 23, 1985

RE: Investigation of Complaints Relative to Natural Gas and

Fresh Water Service by/to Customers on Meades Branch in

Lawrence County, Kentucky

HISTORY AND BRIEF

My January 30, 1985, memo* was followed on February 11 and 12, 1985, by hotline complaints* from residents on Meades Branch. These people do not want their names used--they fear gas and water service cutoffs by a Mr. Kay Pigmon, current operator of the system supplying them natural gas and/or water.

My memo* prompted the earliest possible inspection of the Meades Branch situation. This Report reflects some of the undesirable and potentially hazardous conditions found on my inspection trip. The illicit operation of an utility (KRS 278.010(e)(b) & (d)) is indicated.

INSPECTION/INVESTIGATION

Following the hotline complaints* I made call-backs on February 14, 1985. On these telephone calls* the complainants related their problems with their natural gas and/or fresh water services.

REPORT - Meades Branch Complaint Page Two April 23, 1985

The existence of an organized utility operation was outlined during our telephone conversations.

On March 13 and 14, 1985, I visited Meades Branch, talked to some of the customers, inspected the visible natural gas and water plant facilities, tasted the water and took some photos (see attached Photo Pages 1-7).

Two of the customers gave me various copies of their paid receipts (see Exhibits A-1, 2 and 3 attached). It should be noted that a Mr. Kay Pigmon signed one, initialed others, but only wrote in "Meades Branch Gas" on most of the receipts. I was given Mr. Pigmon's telephone number and have been unsuccessful in my repeated efforts to reach him.

CONCLUSIONS

It has been determined that the telephone is listed in a Ms. Debra A. Pigmon's name, and the mailing address is Route 4, Box 185, Louisa, Kentucky 41230. It has also been determined that Mr. Pigmon personally collects for his gas and water service at a higher rate than the prior operator, Mr. Ed Miller, used to charge. Notwithstanding, the reported discriminatory, unequal service to preferred customers, the impression is that Mr. Pigmon is poorly managing a utility system(s) (i.e. natural gas and fresh water) much in need of improved construction, better maintenance and more attentive operation.

REPORT - Meades Branch Complaint Page Three April 23, 1985

Finally, we can conclude that this/these systems present hazards to the health and safety of Meades Branch residents--customers and others.

RECOMMENDATIONS

It is recommended that the Commission be made aware of this illicit utility operations(s) so that it can order Mr. Kay Pigmon to show cause, if any he can, as to why he should not be required to uprate his utility systems to acceptable safety and health standards according to Commission Law and the regulations thereto.


It is further recommended that the Commission staff Water Section become informed of and involved in the handling of this situation.

Finally, it is recommended that a copy of this Report be sent to Mr. Kay Pigmon, at the above mentioned mailing address, so that he might be advised of our concerns and pending enforcement action.

*My memo and copies of the "Hotline" call notes are available in my work file.


Respectfolly submitted

REB/lr Attachments



Meade's Branch Gas (and Water) March 14, 1985

Natural Gas from this well








This residence is at the ent of the continue (main)




Meade's Branch Gas (and Mater) March 14, 1935

Pressure Regulator*


(1)

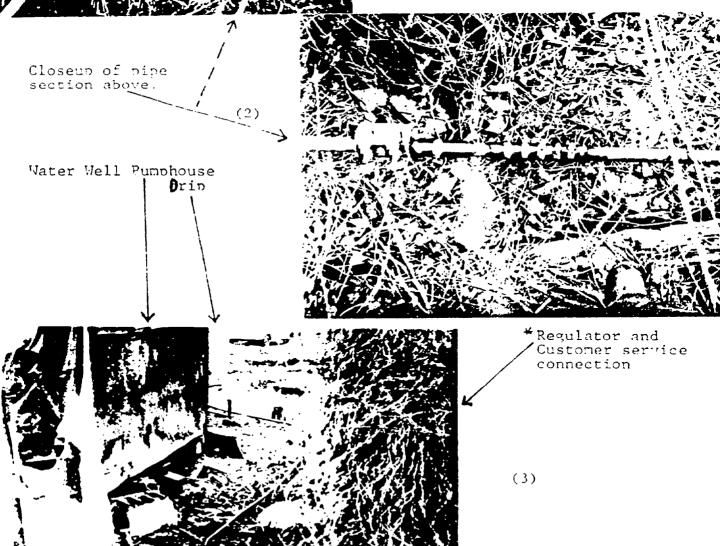

Meade's Branch Gas (& Water) March 14, 1985

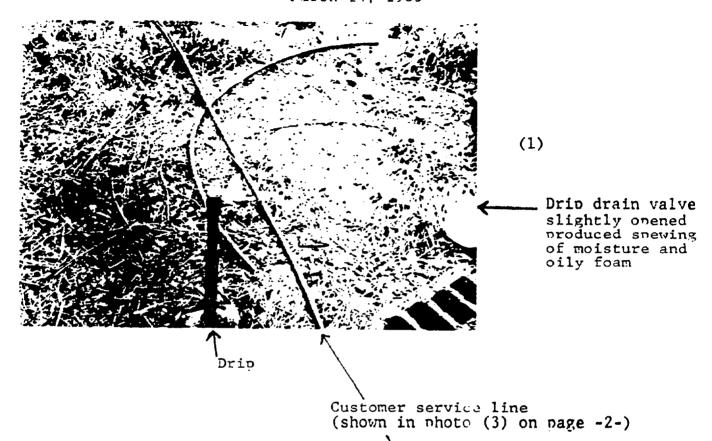

2 photos taken while foam spewed from drip blowoff

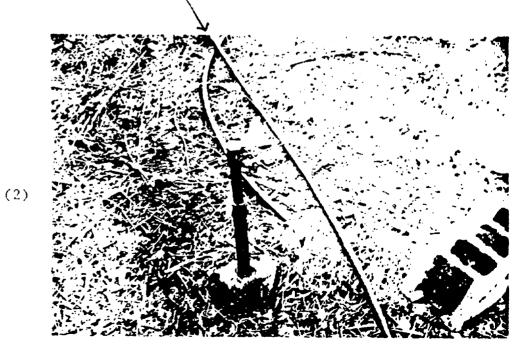

Meade's Branch Cas (& Water) March 14, 1985



Same Customer gas service line* as shown on Pages -2- and -3-

Close up "iew of above utility | Ine(s) intersection



Drain (service) line

Water Main

Photo Page -5-

Meade's Branch Gas (& Water) March 14, 1985

Section of Gas Main where it crosses a drain unstream from the

regulator setting shown on Page -6-

Gas Main

Close up view of drain crossing*



Side Tab_ Cas Main - ... ruite -5-

Meade's Branch Cas (& Mater) March 14, 1985

Customer(s) service pressure regulator setting




Customer service(s) on outlet side

_Close un of pressure regulator on inlet side

Inside view of above customer(s) regulator house


(Note electric light lamp to provide heat)






Meade's Branch Gis (& Water) March 14, 1985


Water main crossing of drain (same drain shown on page -5-)



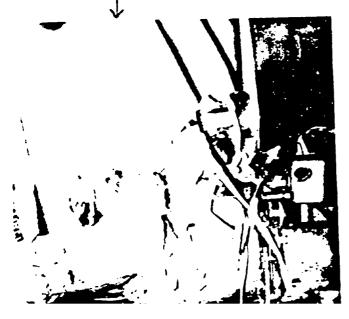


No Received of	July 16, 1984
Leventy dellaw	200/100 Dollars
	Part 15P, 7-6-84

هيود	77007 7084
elan & 00/100.	Dollars.
. 30.00 - Wate	10.00
4 6 June	1984 بر اب
Melder Brauch	Has
	romon
•	*30.00 - Wate 4 6 June Melder Branch

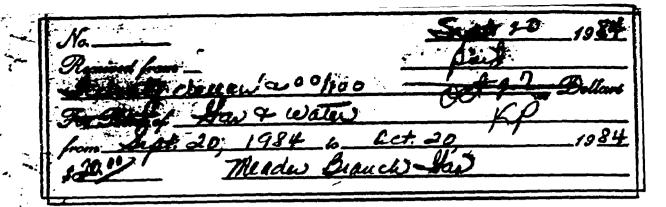

No.	De 24	1984
Reseived from		的物质的
one 1. 1. 19 11. 1. 10 200	<u>}</u>	Wolling.
For Dent of Fra Lunter		
1000 201954 lom	nh 1: 1985	
\$ 137.00 711conles As	well Had	



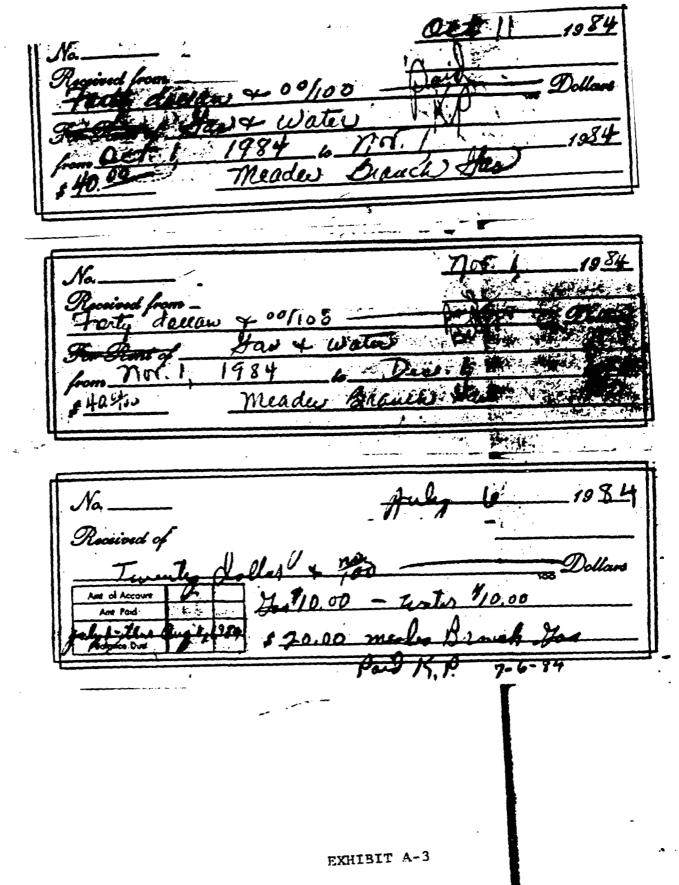

SUMMARY SHEET*

GAS SECTION REPORTS

DATE: 4/23/85
INSPECTOR: Seuf Lav
NATURAL GAS OPERATOR: Menky Branch Gas
Intrestate Interstate
NUMBER OF MAN DAYS: 2 APPROVED: Chief, Gas Section
MODE:
Memo Letter Report
TYPE INSPECTION:
Routine Construction
Other Complaint SNATY + Senvill
COMPLIANCE ACTION: YesNo
DEFICIENCIES: Yes No
CORRECTED DEFICIENCIES: Yes No Number
COMMENTS:
FILE UNDER THE FOLLOWING:

^{*}Complete form and attach original to back of each document when submitted to Section Chief for approval.